



Housekeeping Rules:

Your inspection will be as expedient as possible. Please, follow these rules or it will count as a failed attempt.

- Be on time. 10-minute tolerance only.
- It is your responsibility to power your Food Truck. We provide adaptors but no cables or generators.
- Your unit should be clean and the food in the refrigerator. No active cooking.
- Do not dump oil, trash or wastewater in the property.

You will be inspected on the following points:

- LP-Gas Appliances should be secured to the Food Truck.
- LP-Gas Lines should be in use or capped off.
- LP-Gas Cylinders should be upright and secured from falling, car crashes or bystanders.
 - (Figure 1)**
 - LP-Gas Cylinders should have a visible and accessible shut-off valve.
 - Place an "Emergency Shutoff Valve" sign near the shut-off valve. **(Figure 2)**
 - "No Smoking" sign near the LP-Gas Cylinders. **(Figure 3)**
 - "No Fumar" sign near the LP-Gas Cylinders. **(Figure 3)**
 - LP / Combustible / Explosive Gas Alarm installed near the LP-Gas Appliances. **(Figure 4)**
 - Red Fire Extinguisher ABC 3A:40BC
 - Silver/Gray Fire Extinguisher Type K 2A:K (If you fry food).
 - Type I Ventilation System: **(Figure 5)**
 - No gaps between filters.
 - Regulate the motor to avoid suctioning the filters.
 - Grease rail should have discharge hole.
 - Grease drip pans should be present.
 - Use only vapor / explosion proof lighting only.
 - Service-entry power supply to the Food Truck must be a male inlet in weather rated casing **(Figure 6)** or
 - Service-entry power supply to the Food Truck is a direct connection to the breaker box.
 - Electrical cables should be protected from physical damage.
 - No Extension cords as permanent wiring.
 - Do not overload plugs.





Figure 1. LP-Gas Cylinders must be protected from fall, car crashes or bystanders.

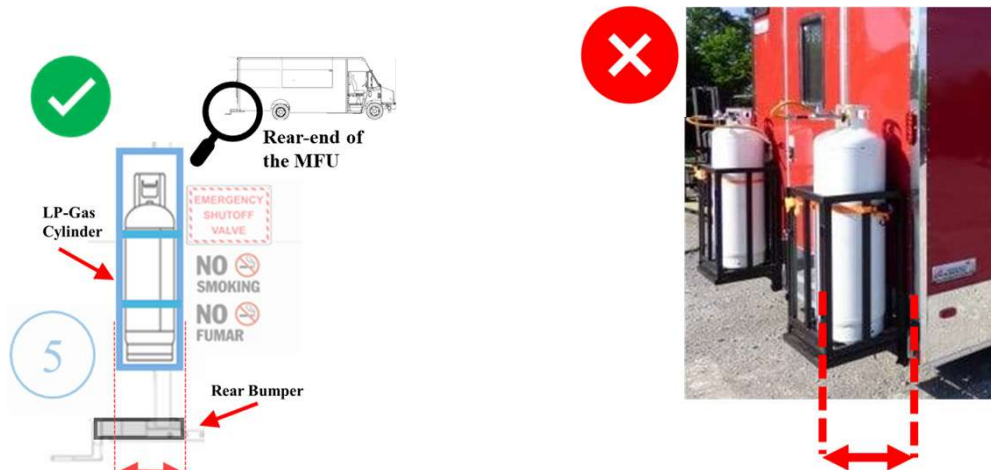

The bumper should protect the LP-Gas Cylinder from rear-end collisions.

The Bumper does NOT protect the LP-Gas Cylinder from rear-end collisions.



Figure 2. Place an “Emergency Shut-off Valve” sign near the valve



Figure 3. Place a “No Smoking” and “No Fumar” signs near the LP-Gas Cylinder



Figure 4. Place a LP-Gas Leak detector near the Appliances. Ensure it detects propane, combustible gas or explosive gas. This device is not a smoke or carbon monoxide detector.



Figure 5. Keep your ventilation system clean and free of soot or grease. Place vapor / explosion proof lighting only inside the vent hood. Ensure there are no gaps between the filters. Regulate the extractor band to avoid suctioning the filters. The grease rail must have a drain into the pan.

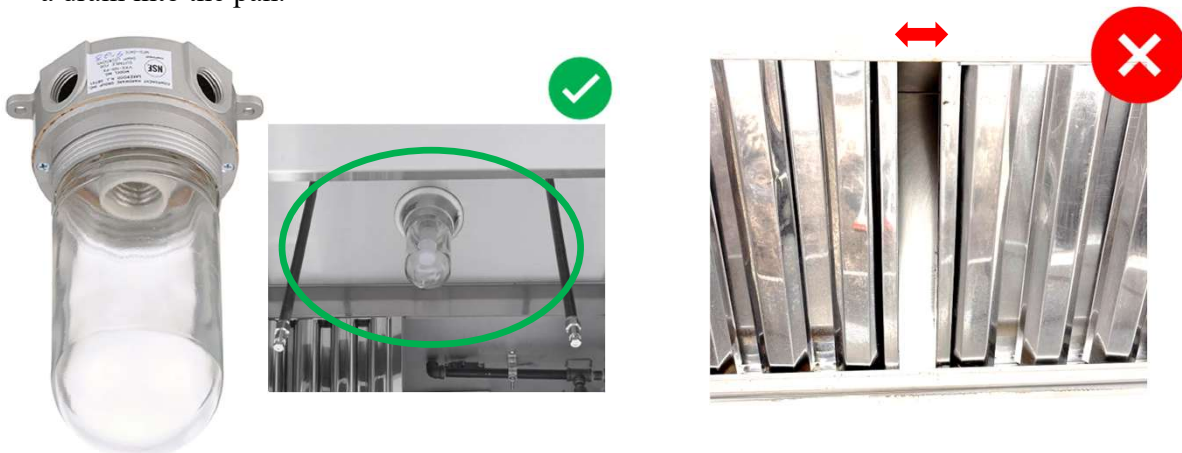


Figure 6. Your service-entry power supply shall have a male inlet, secured to the Food truck, in a weather rated casing or a direct connection to the breaker box. Never use a double male connection.



The *Double-male connection* is also known as “The Suicide Cord” or “The Widow-maker”.